










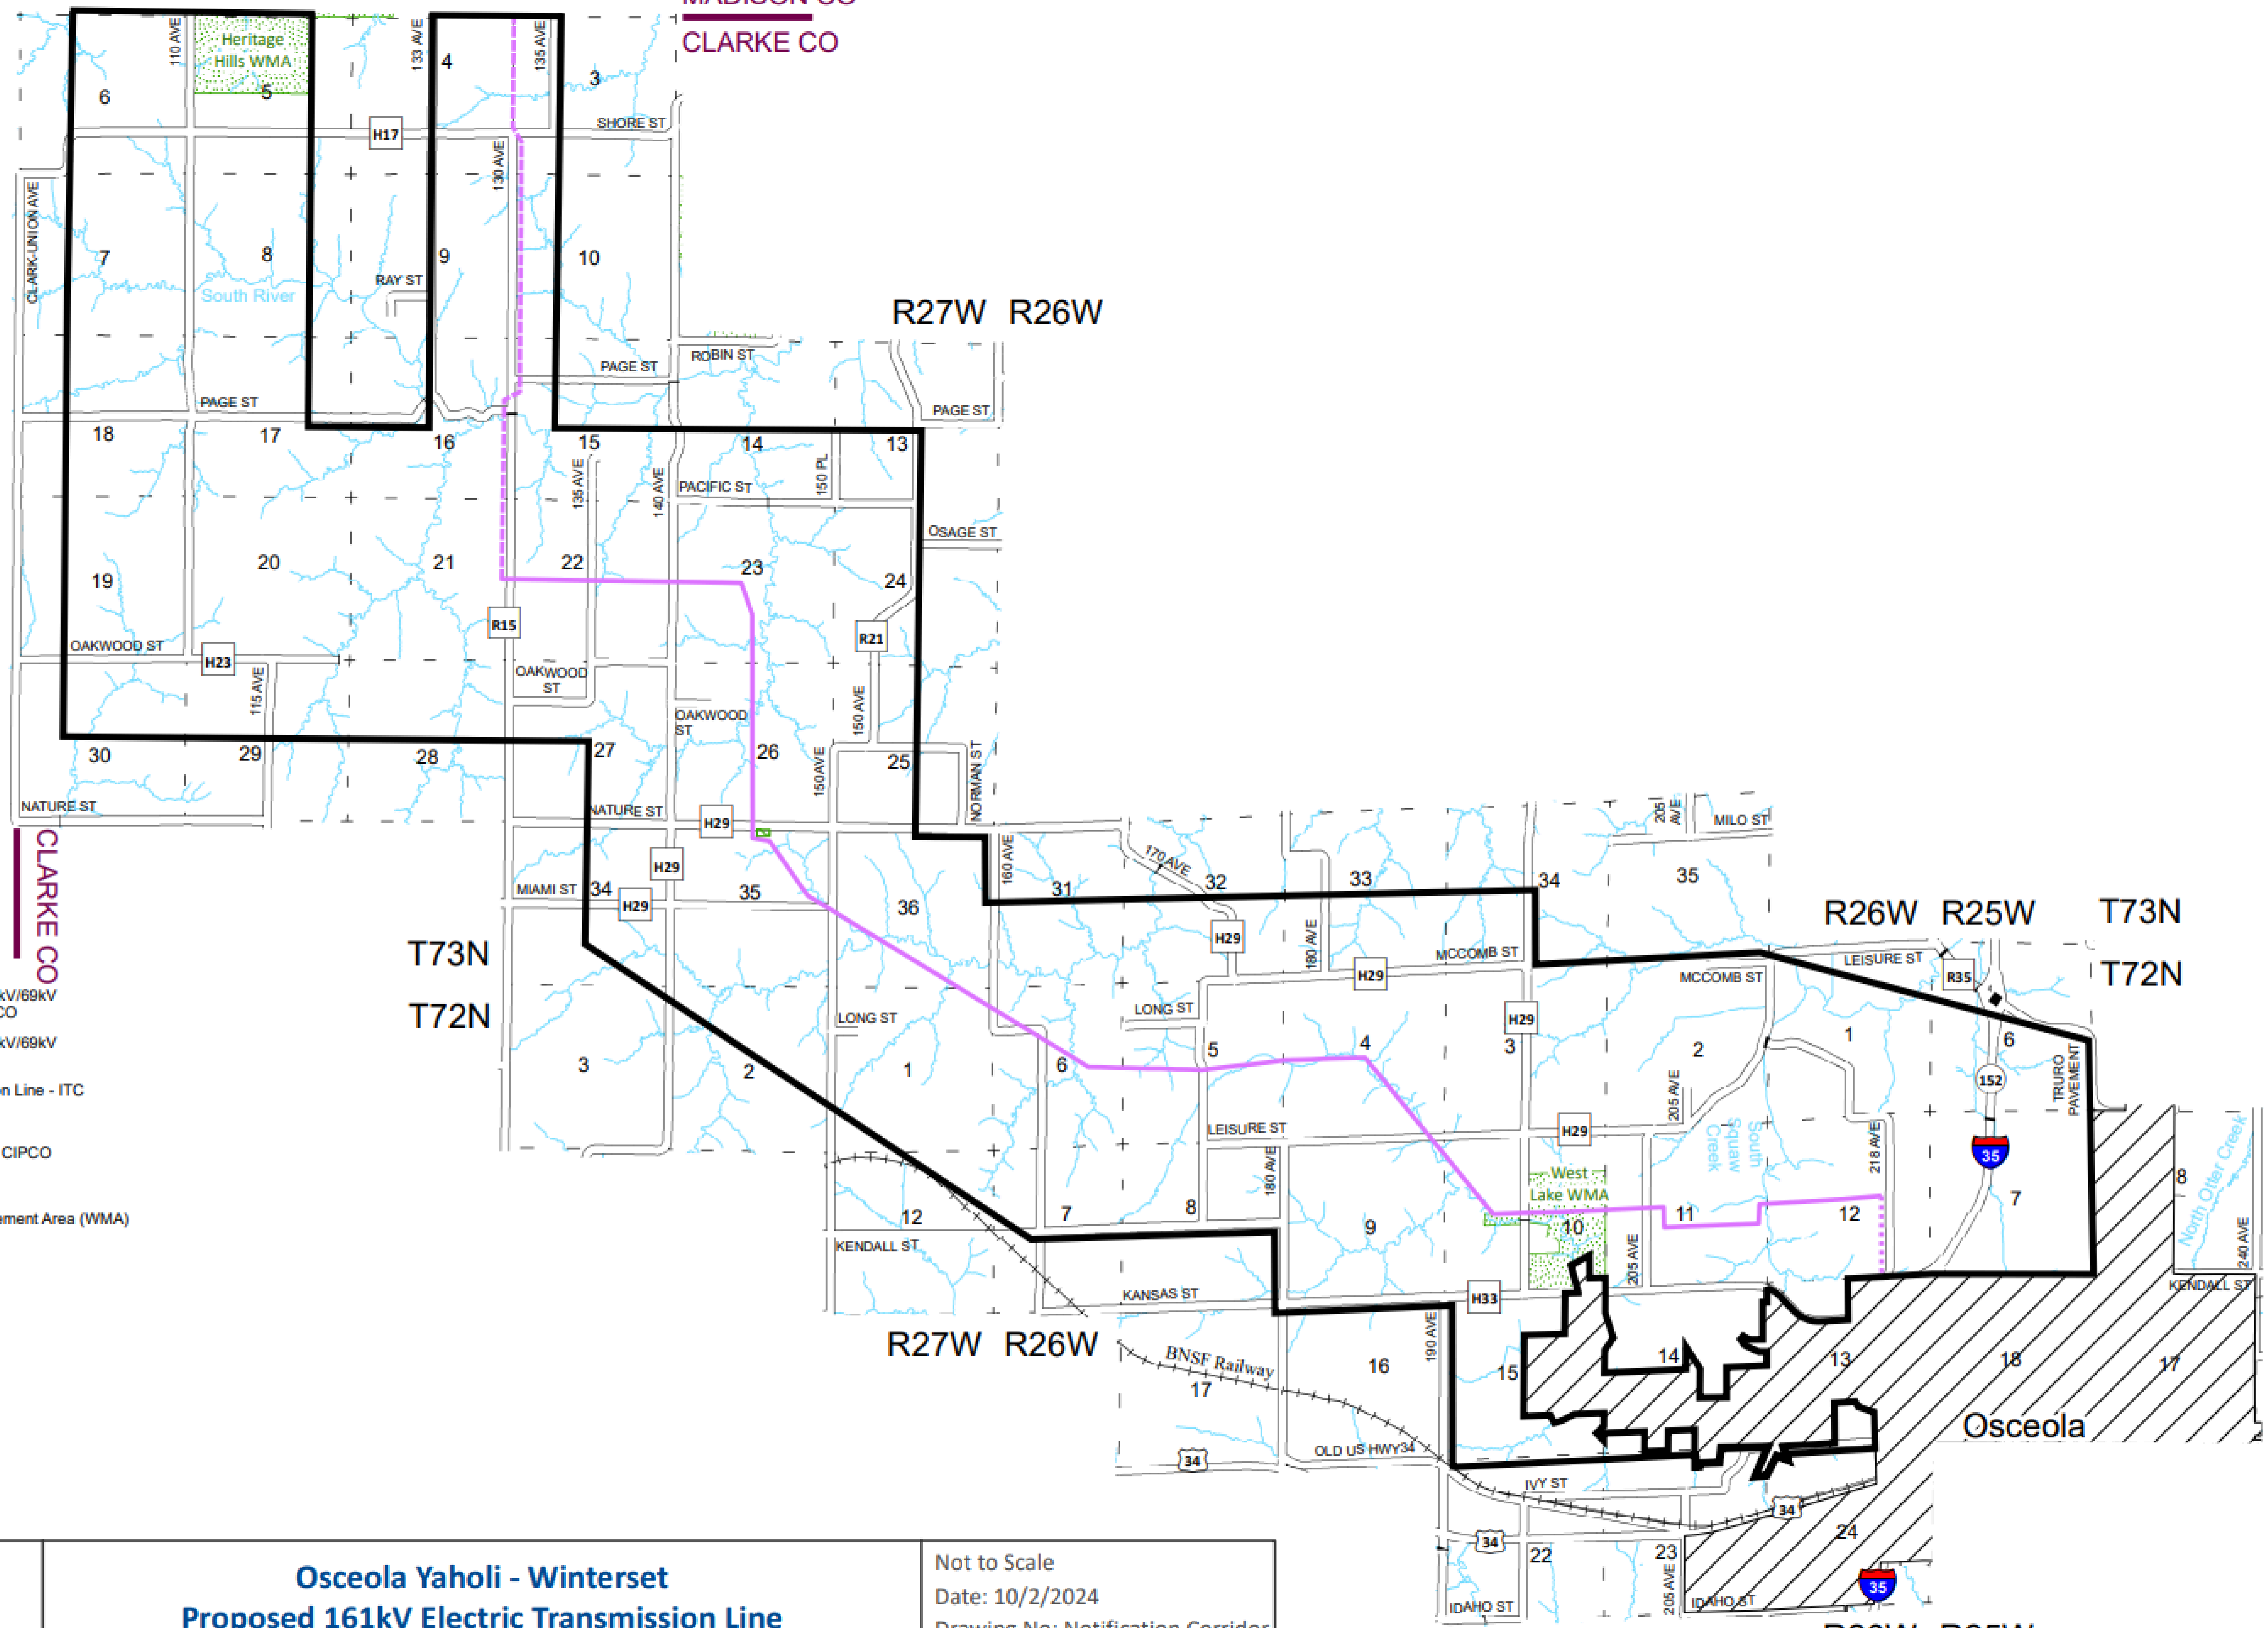







MADISON CO
CLARKE CO



LEGEND

-  Proposed Double Circuit 161kV/69kV Transmission Line - ITC/CIPCO
-  Proposed Double Circuit 161kV/69kV Transmission Line - ITC
-  Proposed 161kV Transmission Line - ITC
-  Notification Corridor
-  Murray Junction Substation - CIPCO
-  Corporate Limits
-  Public Lands/Wildlife Management Area (WMA)
-  Section Line
-  Hydrology
-  Railroad
-  Bridges
-  Roads
-  County Highway
-  State Highway
-  US Highway
-  Interstate Highway



Osceola Yaholi - Winterset
Proposed 161kV Electric Transmission Line
 Clarke County, IA

Not to Scale
 Date: 10/2/2024
 Drawing No: Notification Corridor
 Page: 1 of 1

R26W R25W